

# SIMULATION OF NETWORK SYSTEMS BASED ON LOOP FLOWS ALGORITHMS

CORNELIU ARSENE, ANDRZEJ BARGIELA and DAVID AL-DABASS

*School of Computing and Mathematics  
Nottingham Trent University  
Nottingham NG1 4B  
[corneliu.arsene@doc.ntu.ac.uk](mailto:corneliu.arsene@doc.ntu.ac.uk)*

**Abstracts:** This paper presents a simulation scheme for water distribution systems based on loop flows algorithms. Water networks are large scale and non-linear systems. The operational control of such system has posed difficulties in the past to the human operator that had to take the right decisions, such as pumping more water or closing a valve, within a short period of time and quite frequently in the absence of reliable measurement information such as pressure and flow values. Computer simulations of such systems have alleviated these difficulties. They allowed 'what-if' scenarios to be run by the human operator, giving him the possibility to know in advance the operational problems that can arise in the real-life networks due to malfunctions of valves or burst in pipes. However these computer simulations are generally relying on solving a system of equations and the nodal heads variables have been the most frequently used variables in these computer simulations. More recently the numerical algorithms based on loop corrective flows have started to receive more attention due to the reduce size of the matrixes involved in the numerical computations, which relies on the loop structure of the water network rather than the nodes. This can improve the numerical properties of the algorithms that model the real-time behaviour of the network. It is shown that such an efficient simulation scheme can be developed in the context of the loop flows algorithms and some problems that appear from doing this are successfully solved.

**keywords:** Modeling and simulation, state estimation, network systems, loop flows algorithms.

## 1. INTRODUCTION

Water network simulation provides a fast and efficient way of predicting the network behavior, calculating pipe flows, velocities, head-losses, pressures and heads, reservoir levels, reservoir inflows and outflows and operating costs.

Simulation of real water distribution systems, that do not consist of a single pipe and cannot be described by a single equation, consists of solving a system of equations. The first systematic approach for solving these equations was developed by Hardy Cross (Cross, 1936). The invention of digital computers allowed powerful numerical technique to be developed that set up and solve the system of equations describing the hydraulics of the network in matrix form. These numerical methods can be classified as the numerical minimization methods (Contro & Franzetti, 1982), the Hardy-Cross method (Chenoweth & Crawford, 1974), the Newton-Raphson method (Donachie, 1974) and the Linear Theory method (Collins & Johnson, 1975). The last three classes include methods used for the solution of systems of non-linear equations, while the first deals with the search of minimum of a non-linear convex

function under linear equality and inequality constraints. Irrespective of the numerical procedure used, the simulation of water networks has led to the development of many methods of network flow analysis using various types of decompositions. Each decomposition expresses the resulting system of equations in terms of a specific type of independent variables: the link flow  $Q$  (Wood & Charles, 1972), the loop corrective flows  $\Delta Q_l$  (Epp & Fowler, 1970; Gofman & Rodeh, 1982), and the nodal heads  $H$  (Jeppson, 1975). In order to asses the relative merits of the different formulations for solving large pipe network problems, the comparison can be made in terms of simplicity of input, initial solution, size of the system of linear equations and efficiency of solution of the system of equations. The balance of these merits made the combination of the nodal heads and the Newton-Raphson algorithm to be the most frequently used procedure for solving water networks (Rahal, 1980; Powell et al., 1988). Extended time simulations which are used to evaluate system performance over time and allows the human operator to model tanks filling and draining, valves opening and closing, have been implemented based on nodal heads equations (Rao et al. 1978). However the use of nodal equations in network flow analysis has

disclosed a couple of weaknesses. In (Nielsen, 1989) it has been reported that nodal heads based algorithms have weak convergence for the parts of water network containing low pipe flows.

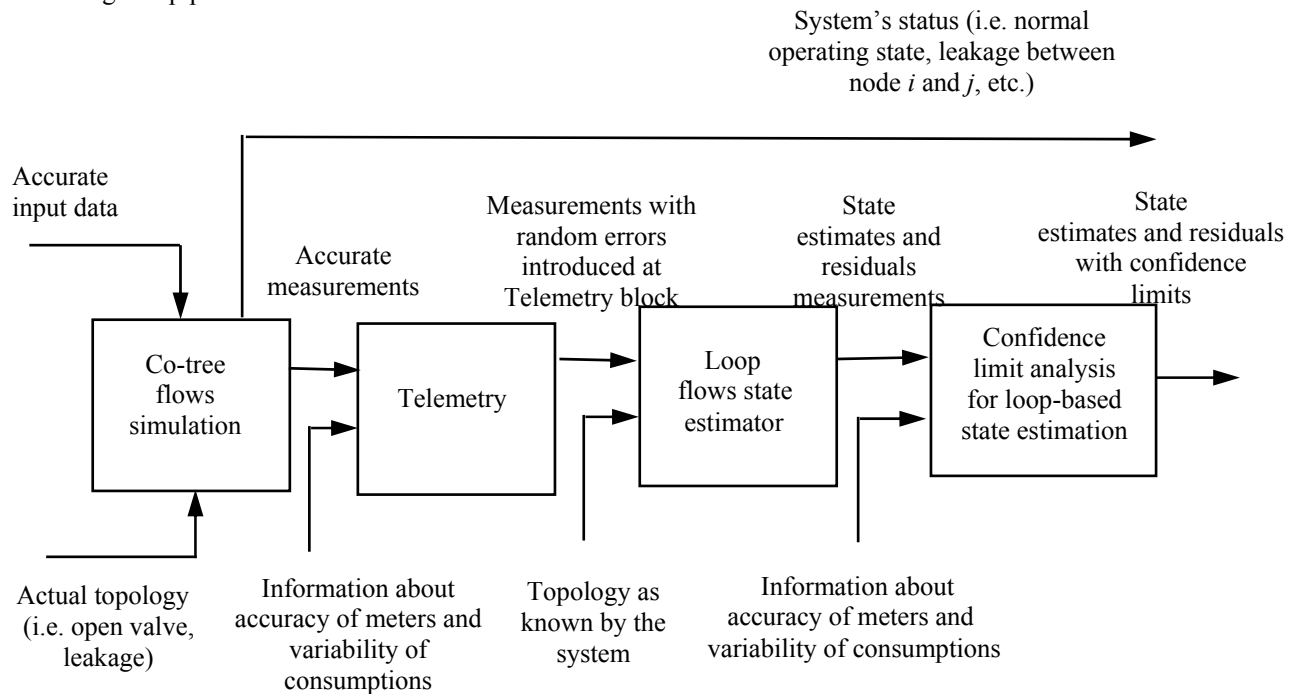


Fig. 1. Operational control of water distribution systems using the loop equations in the simulation algorithms.

Finally, the combination of the Newton-Raphson method and the loop corrective flows is called the loop system of equations. Over the last decade the numerical simulations based on loop equations have received an increased attention. It has been shown that using the loop equations is a suitable framework for the inclusion of pressure-controlling elements without specifying the operational state of the network (Andersen & Powell, 1999b). Moreover a rapid convergence has been reported (Andersen & Powell, 1999a; Rahal, 1995) for the simulations of water networks based on the co-tree formulation that is derived from the loop equations method. Although the results were encouraging, no further efforts have been made for developing a fully integrated simulation scheme for on-line monitoring of water networks based on loop equations. This simulation scheme should act as a decision support system that would assist the operational engineer in taking the right decision (e.g. open/close valve) with regard to the status of the distribution system. In this paper we develop such a simulation scheme based on loop flows algorithms.

## 2. OPERATIONAL CONTROL BASED ON LOOP FLOWS ALGORITHMS

The operational control of water systems (e.g. decisions concerning water pumping schedules, pressure control measures, leakage monitoring) is a challenging problem because the models are non-linear and large scale and the measurement information (i.e. pressure and pipe flows or predictions of nodal consumptions) is noisy and frequently incomplete.

In this paper the operational decision system for water networks is to be attempted by the block diagram shown at Fig. 1. The figure consists of four simulation blocks: (1) Co-tree flows simulator; (2) Telemetry block; (3) State estimation; and (4) Confidence Limit Analysis (CLA) algorithms. In the following section, each of the blocks will be shortly presented.

### 2.1 Co-Tree Flows Simulator Algorithm

A simulator algorithm represents a snapshot in time and is used to determine the operating behaviour of the water network for a set of nodal demands. The

simulation algorithm shown here is based on a co-tree flows formulation, which is derived from the loop corrective flows algorithm, defined for a water distribution system with  $n$ -nodes,  $l$ -loops, and  $p$ -pipes.

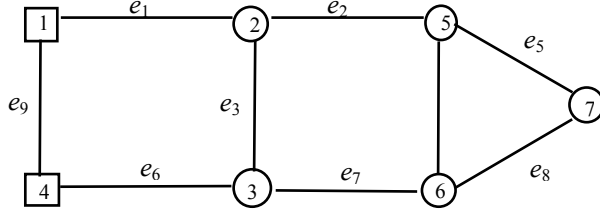


Fig. 2. Water Network from Gofman and Rodeh (1982).

We note with  $A_{np}$  ( $n \times p$ ) the topological incidence matrix that has a row for every node and a column for every branch (component) of the network. The non-zero entries for each row +1 and -1 indicate that the flow in pipe  $j$  enters or leaves node  $i$ .

$$A_{np}(i, j) = \begin{cases} 1 & \text{flow of pipe } j \text{ enters node } i \\ 0 & \text{pipe } j \text{ is not connected with node } i \\ -1 & \text{flow of pipe } j \text{ leaves node } i \end{cases} \quad (1)$$

The loop incidence matrix  $M_{lp}$  is the ( $l \times p$ ) matrix with the following properties:

$$M_{lp}(j, k) = \begin{cases} 1 & \text{flow of pipe } k \text{ flows clockwise in loop } j \\ 0 & \text{pipe } k \text{ does not pertain to loop } j \\ -1 & \text{flow of pipe } k \text{ flows anti-clockwise in loop } j \end{cases} \quad (2)$$

The co-tree flows simulator algorithm is based on the decomposition of the water network in a spanning tree. A spanning tree for a network (with  $n$  nodes and  $p$  pipes) is a subnetwork (with  $n^1$  nodes and  $p^1$  pipes) such that  $n = n^1$  and the subnetwork contains at least one pipe and no loops, and is said to be *connected*. A network is connected if for every pair of different nodes  $n_1$  and  $n_2$ , there is a *path* between them. A path represents a finite sequence of nodes and pipes between the initial node  $n_1$  and the terminal node  $n_2$  and no node or pipe is repeated in the path. The pipes that do not belong to the spanning tree and are called *co-tree* pipes or *chords* (e.g. dashed arrows in Fig. 3), and are providing the loop information.

Different search strategies can be employed in order to produce the spanning tree. In this paper the Depth First (DF) search has been used to obtain the network information (i.e. the spanning tree, the loop and the topological incidence matrixes) (Gofman & Rodeh,

1982; Andersen & Powell, 1999b). Concomitant with building the spanning tree, new labels are assigned to pipes and nodes during the search of the water network so that to model the topological incidence matrix as an upper form tree incidence matrix  $T$  and a co-tree incidence matrix  $C$  (i.e.  $A_{np} = [T \ C]$ ).

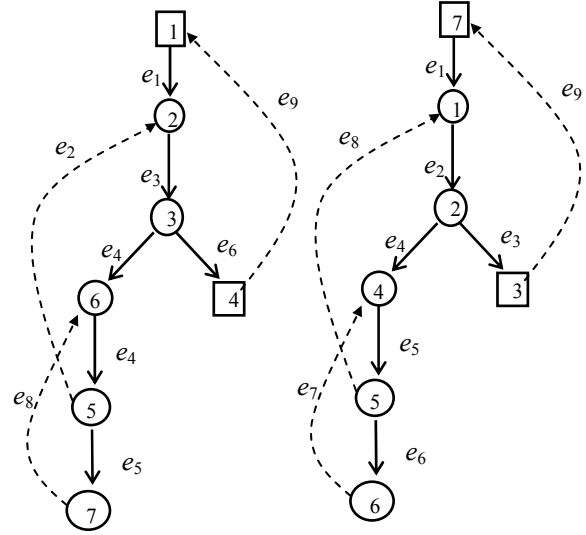


Fig. 3. a) Spanning tree for the water network from Fig. 2, b) New labels for pipes and nodes.

Based on the DF search the topological and the loop incidence matrixes are obtained. The co-tree flows simulator algorithm requires that the initial flows  $Q_i$  to respect the mass continuity equation (i.e. the amount of flow that enters to a node equals the amount of flow that leaves the node plus the water consumption in the respective node). This is because the governing system of equations of the co-tree flows simulator algorithm does not account either implicitly or explicitly for continuity. The initial flows  $Q_{Ti}$  in tree pipes can be calculated as follows:

$$Q_{Ti} = T^{-1} d \quad (3)$$

The co-tree flows simulator algorithm consists of the energy equation that has to be satisfied, that is the vector of loop head losses residuals  $\Delta H$  ( $l \times 1$ ) must be equal to zero:

$$\Delta H = 0 \quad (4)$$

The vector of loop head losses residuals  $\Delta H$  can be written as:

$$\Delta H = M_{lp} h \quad (5)$$

where  $h$  ( $p \times 1$ ) is the vector of pipe head losses described by the Hazen-Williams equation:

$$h = k \tilde{Q}^n \quad (6)$$

Here  $k$  ( $p \times 1$ ) is the vector of pipe resistance coefficients and  $\tilde{Q}$  ( $p \times 1$ ) is the vector of pipe flows that we want to determine. Equation (5) is solved with the Newton-Raphson method which is a well-known numerical method for solving a system of non-linear equations.

$$\Delta Q_{l_{t+1}} = \Delta Q_{l_t} - \left[ \frac{\partial \Delta H}{\partial \Delta Q_{l_t}} \right]^{-1} \Delta H \quad (7)$$

The matrix  $\frac{\partial \Delta H}{\partial \Delta Q_{l_t}}$  ( $l \times l$ ) is the Jacobian matrix, that is the derivatives of the loop head losses residuals  $\Delta H$  with respect to the loop corrective flows  $\Delta Q_{l_t}$  at the  $t$ -th step of the Newton-Raphson process.

For the co-tree flows simulator algorithm the solution is given by vector of pipe flows  $\tilde{Q}$ :

$$\tilde{Q} = Q_i + M_{pl} \Delta Q_l \quad (8)$$

where  $M_{pl}$  ( $p \times l$ ) is the transpose of the loop incidence matrix and  $\Delta Q_l$  ( $l \times 1$ ) is the vector of loop corrective flows.

While for the well maintained water distribution systems the normal operating state data can be found in abundance the instances of abnormal events (e.g. leakages) are not that readily available. In order to observe the effects of abnormal events in the physical system one sometimes is forced to resort to deliberate closing of valves or opening of hydrants (to simulate leakages) (Carpentier & Cohen, 1993). Although such experiments can be very useful to confirm the agreement between the behaviour of the physical system and the mathematical model, it is not feasible to carry out such experiments for all pipes and valves in the system during the whole day or days as might be required in order to obtain the representative set of labeled data.

It is an accepted practice that, for processes where the physical interference is not recommended or even dangerous, mathematical models and computer simulations are used to predict the consequences of some emergencies so that one might be prepared for

quick response. In conclusion the co-tree flows simulator algorithm from Fig. 1 is used not only to simulate the normal operational point of a water network but also to predict the consequences of some emergencies so that one might be prepared for quick response.

Furthermore the accurate pressure and flow values obtained from the co-tree flows simulator algorithm are input into the “telemetry” block where random errors, with values defined by the accuracy of meters and the maximum variability of consumptions, are added to accurate measurements to simulate the noisy environment of the real water distribution system. These noisy measurements are sent to the “estimation” block that calculates, for a given measurement set, the state estimates.

## 2.2 Loop Flows State Estimator

In the operational decision support of water networks, state estimation is an important element that enables processing of diverse measurements obtained via the real-time telemetry systems and facilitates calculation of the best approximation of the operational state of the system.

The state estimation can be viewed as the process of optimisation of a suitably chosen cost function and the least square (LS) criterion where the sum of the squared differences between the measured and estimated values is minimised, has been intensively used in the operational control of water networks.

The nodal heads equations have been predominantly used as the state variables in the LS state estimators. Although the mathematical model is accurate, it leads sometime to difficulties in modeling and simulation of realistic water networks (Nielsen, 1989; Gabrys & Bargiela, 1996; Sterling & Bargiela, 1984; Powell et al., 1988; Hartley and Bargiela, 1993). An alternative to the nodal heads equations are the loop corrective flows. This can be an advantage because of the smaller size of the matrixes involved in the numerical computations. A WLS state estimator based on the loop equations and the state variables were the unknown nodal demands was presented in Andersen and Powell (1999a). The minimization problem was solved using a Lagrangian approach. A LS state estimator was shown in Arsene and Bargiela (2001) that employed both the variation of nodal demands and the loop corrective flows as independent variables. The novel state estimator is briefly depicted in the following paragraph.

An additional set of variables has been considered, that is the variation of nodal demands  $\Delta d$ . Hence the hydraulic model  $g()$  for head, flow and demand measurements becomes a function of both the loop corrective flows  $\Delta Q_l$  and the variation of nodal demands  $\Delta d$ . The advantage of using the variation of nodal demands is that we are able to write the network equations based on the topological information obtained from the spanning tree.

The pipe flows will be written function of the loop corrective flows  $\Delta Q_l$  and the variation of nodal demands  $\Delta d$  as follows:

$$\tilde{Q} = Q_i - A^* \Delta d + M_{pl} \Delta Q_l \quad (9)$$

where  $\tilde{Q}$  are the pipe flows in tree and co-tree pipes,

$Q_i = \begin{bmatrix} Q_{Ti} \\ 0_l \end{bmatrix}$  are the initial flows in tree pipes and co-

tree pipes (i.e. zero vector  $0_l$  ( $1 \times l$ )), and matrix  $A^*$  is

the matrix with the property  $A^* = \begin{bmatrix} T^{-1} \\ 0 \\ I_n \end{bmatrix}$ . There are

two sets of equations which will be used to describe the hydraulics of the water network.

The first set of equations states that the loop head losses around the loops are equal to zero:

$$\Delta H(\Delta Q_l, \Delta d) = 0 \quad (10)$$

where the loop head losses residuals  $\Delta H$  are a function of the loop corrective flows  $y$  ( $\Delta Q_l$ ) and the variation of nodal demands  $x$  ( $\Delta d$ ) and are calculated from equation (5).

The second set of equations states that the total amount of inflow/outflow from the water network carried out through the fixed-head nodes should equal the variation of nodal demands. This equation can be written as follows:

$$\Delta d = B_{nl} \Delta Q_l \quad (11)$$

The matrix  $B_{nl}$  ( $n \times l$ ) from equation (11) has a non-zero element equal to 1 which corresponds to the main root node and -1 for each of the fixed-head nodes.

The equations (10) and (11) represents the hydraulic function that describes the water network. It can be written as a system of equations:

$$\begin{cases} \Delta H(\Delta Q_l, \Delta d) = 0 \\ B_{nl} \Delta Q_l - \Delta d = 0 \end{cases} \quad (12)$$

If we denote with  $g(\hat{x}, \hat{y})$  the non-linear equation that describes the residuals in the loop head losses and the variation of nodal demands then the variation of the state variables  $\begin{bmatrix} \Delta \hat{x} \\ \Delta \hat{y} \end{bmatrix}$  (loop corrective flows and variation of nodal demands) during the Newton-Raphson method is calculated as:

$$\begin{bmatrix} \Delta \hat{x} \\ \Delta \hat{y} \end{bmatrix} = (J^T J)^{-1} J^T g(\hat{x}, \hat{y}) \quad (13)$$

The matrix  $J$  represents the jacobian matrix (i.e. first derivative of function  $g$ ) and it has been presented in Arsene and Barigela (2001).

$$J = \begin{bmatrix} \frac{\partial \Delta H}{\partial \hat{x}} & \frac{\partial \Delta H}{\partial \hat{y}} \\ -I_{nn} & 0 \end{bmatrix} \quad (14)$$

where  $I_{nn}$  is the square identity matrix of size  $n$ .

Now the LS estimate of  $\begin{bmatrix} \hat{x} \\ \hat{y} \end{bmatrix}$  can be found with an iterative process with the consecutive state estimates calculated with the following equation:

$$\begin{bmatrix} \hat{x}^{(k+1)} \\ \hat{y}^{(k+1)} \end{bmatrix} = \begin{bmatrix} \hat{x}^{(k)} \\ \hat{y}^{(k)} \end{bmatrix} + \begin{bmatrix} \Delta \hat{x}^{(k)} \\ \Delta \hat{y}^{(k)} \end{bmatrix} \quad (15)$$

If all elements of  $\begin{bmatrix} \Delta \hat{x}^{(k)} \\ \Delta \hat{y}^{(k)} \end{bmatrix}$  at  $k$ -th step of the estimation process are lower or equal to a predefined convergence accuracy, the iteration procedure stops. Otherwise, a new correction vector is calculated using equation (15) with  $\begin{bmatrix} \hat{x}^{(k+1)} \\ \hat{y}^{(k+1)} \end{bmatrix}$  instead of  $\begin{bmatrix} \hat{x}^{(k)} \\ \hat{y}^{(k)} \end{bmatrix}$ .

Both the co-tree flows simulator and the loop flows state estimator have been tested on real water networks and the numerical results have shown good convergence (Arsene & Barigela, 2001; Bargiela, Arsene & Tanaka, 2002).

### 2.3 Confidence limit analysis - Loop Flows Approach

The measurement uncertainty has an impact on the accuracy with which the state estimates are calculated. It is important, therefore, that the system operators are given not only the values of flows and pressures in the network at any instant of time but also that they have some indications of how reliable these values are. The procedure for the quantification of the inaccuracy of the state estimates caused by the input data uncertainty was developed in the late 1980s and termed Confidence Limit Analysis (CLA) (Bargiela & Hainsworth, 1989). Rather than a single deterministic state estimate, the CLA enables the calculation of a set of all feasible states corresponding to a given level of measurement uncertainty. The set is presented in the form of upper and lower bounds for individual variables and hence provide limits on the potential error of each variable (Gabrys & Bargiela, 1996).

This section addresses the problem of CLA based on the loop flows state estimator and the co-tree flows simulator algorithm shown in the previous paragraphs.

In normal use, deterministic state estimators produce one set of state variables for one measurement vector. Used in this way, they give no indication of how the state variables may be affected by the fuzziness of input data. Alternatively, if a deterministic state estimator is used repeatedly for each measurement modified with its defined maximum variability, then a matrix  $S^e$  can be determined as:

$$S^e = \frac{\Delta x_i}{\Delta z_j} \quad i=1, \dots, n; j=1, \dots, m \quad (16)$$

where  $i=1, \dots, n$  is the index for the state vector denoted with  $x^f$  (nodal heads and in/out flows) and  $j=1, \dots, m$  is the index for the measurement vector denoted with  $z^f$ . The measurement vector  $z^f$  comprises the estimates for the water consumptions and the fixed-head nodes. It can be augmented with real pressure and flow meters.

The loop flows state estimator has been the deterministic state estimator used to obtain the Experimental Sensitivity Matrix. Matrix  $S^e$  is called the Experimental Sensitivity Matrix (ESM) because is obtained through a number of successive simulations. It expresses the variation,  $\Delta x$ , of the  $i$ -th element,  $x_i$ , of the true state vector,  $x^f$ , because of a perturbation,

$\Delta z$ , in the  $j$ -th element,  $z_j$ , of the true measurement vector  $z^f$ . The true state of the system is not known but instead the best state vector available  $\hat{x}$  is used in the process of determining the sensitivity matrix and the confidence limits.

Having found matrix  $S^e$ , we can carry out the maximization process expressed by equation (17) in order to obtain the confidence limits for the state variables. For the  $i$ -th state variable, calculating its error bound  $x_{cli}$  is done by maximizing the product between the  $i$ -th row of the experimental sensitivity matrix  $s_i$  and the vector  $\Delta z$ . The maximization process is performed separately for each row of the sensitivity matrix determined in the previous section.

$$x_{cli} = \max s_i \Delta z \quad (17)$$

The method presented here gives comparable results with the confidence limits analysis algorithms developed in the context of the nodal heads state estimator (Arsene, 2004).

### 3. NUMERICAL RESULTS

While for the well maintained water distribution systems the normal operating state data can be found in abundance, extended time simulations (i.e. simulations that stretch over longer periods of time) or instances of abnormal events are not that readily available. In order to observe the effects of abnormal events in the physical system one sometimes is forced to resort to deliberate closing of valves or opening of hydrants (to simulate leakages) (Carpentier & Cohen, 1993). Although such experiments can be very useful to confirm the agreement between the behaviour of the physical system and the mathematical model, it is not feasible to carry out such experiments for all pipes and valves in the system during the whole day or days.

It is an accepted practice that, for processes where the physical interference is not recommended or even dangerous, mathematical models and computer simulations are used to predict the consequences of some emergencies so that one might be prepared for quick response. The block diagram depicted at Fig. 1 was used to generate data covering 24 hour period for the water distribution network shown at Fig. 4. The reason for choosing this network is that we were able to compare the numerical results obtained in the context of loop algorithms with the numerical results presented in Gabrys (1997) for the same water network and operational testing conditions in the context of the nodal heads equations.



of the 9144 patterns of data was 15 minutes. However by using graph and simple matrix operations as the one described by equations (18), (19) and (20) we were able to reduce the computational time to 40 seconds which is comparable with the CPU times obtained with the nodal heads equations.

### 3. CONCLUSIONS

The purpose of this paper was to investigate the implications of the loop equations formulation of the simulator algorithm, state estimation procedure and confidence limit analysis for the implementation of decision support systems in the operational control of water networks. The nonlinear models and large scale of the water distribution systems made them both a challenging problem to be tackled and a very good validation example for a prototype decision support system useful in other utility systems.

The paper has been divided in two distinctive parts. In the first part, we used the loop equations for the implementation of a co-tree flows simulator algorithm, we presented a novel loop flows state estimator, and a confidence limits analysis algorithm based on the loop flows variables. A particular emphasis has been placed on the fast calculation of the initial input data (the incidence matrixes and the initial pipe flows), enhancement and accuracy of the results and good convergence properties for the numerical algorithms.

The second part of the paper was concerned with combining the numerical algorithms in an efficient simulation block scheme for a 34-node water network. It has been shown that instead of carrying out the time consuming process of re-building the spanning for each simulation in the series of extended time simulations or for leakage simulations, graph and matrix operations can be used in order to drastically reduce the CPU times. We can conclude that all the developed modules have been successfully integrated into an efficient simulation scheme that has been used to generate numerical data for a realistic 34-node water network without having to actually carry out experiments for pipes and valves in the real-life system during the whole day or days.

**BIOGRAPHY:** Corneliu Arsene has just finished his PhD studies in Operational Decision Support of Network Systems in the School of Computing & Technology, The Nottingham Trent University. After graduating from Polytechnical University of Bucharest in 1998 with BEng in Control Engineering, he worked for Automation Engineering Institute in

Bucharest, Romania until 1999. Between 1998 and 1999, he also completed an MSc. degree in Intelligent Systems and Bioengineering at The Polytechnic University of Bucharest. In 2003 he held a research fellowships at The Department of Civil Engineering, The University of Liverpool. For more details on his research and past activities you can e-mail him: [corneliu.arsene@doc.ntu.ac.uk](mailto:corneliu.arsene@doc.ntu.ac.uk)

### REFERENCES

- [1] Arsene C.T.C., *Operational decision support in the presence of uncertainties*, Ph.D. Thesis, Nottingham Trent University, 2004.
- [2] Andersen, J. H., and R.S. Powell, "A loop based simulator and implicit state-estimator", *Water industry systems: modelling and optimisation applications*, In B. Coulbeck, and B. Ulanicki (Series Ed.) and D. A. Savic and G. A. Walters (Eds.), vol. 1, pp. 75-87, Research Studies Press, 1999a.
- [3] Andersen, J. H., and R.S. Powell, "Simulation of water networking containing controlling elements", *J. Water Resources Planning and Management*, 125(3), pp. 162-169, 1999b.
- [4] Arsene, C. T. C., and A. Bargiela, "Decision support for forecasting and fault diagnosis in water distribution systems – robust loop flows state estimation", *Water software systems: theory and applications*, In B. Coulbeck, and B. Ulanicki (Series Eds.) and B. Ulanicky and B. Coulbeck, and J. P. Rance (Eds.), vol. 1, pp. 133-145, 2001.
- [5] Bargiela, A., C.T.C. Arsene, and M. Tanaka, "Knowledge-based neurocomputing for operational decision support", *International Conference on Knowledge-Based Intelligent Information & Engineering Systems*, Milan, Italy, 2002.
- [6] Bargiela A. and G.D. Hainsworth, "Pressure and Flow Uncertainty in Water Systems", *J. of Water Resources Plan and Management*, vol.115, no 2, pp.212-29, March 1989.
- [7] Carpentier, P. and G. Cohen, "Applied mathematics in water supply network management.", *Automatica*, vol. 29, no.5, pp.1215-1250, 1993.
- [8] Chenoweth, H., and C. Crawford, "Pipe network analysis", *J. American Water Works Association*, vol. 66, pp.55-58, 1974.
- [9] Collins, M., L. Cooper, R. Helgason, J. Kennington, and Le Blanc L., "Solving the pipe network analysis problem using optimisation

- techniques”, *Management Science*, vol. 24, pp.747-760, 1978.
- [10] Collins, A.G. and R.L. Johnson, “Finite-element method for water distribution networks”, *J. American Water Works Association*, vol. 67, pp. 385-389, 1975.
- [11] Donachie, R.P., “Digital Program for water network analysis”, *J. of Hydr. Div.*, vol.3, pp.48-59, 1974.
- [12] Eggener, C.L. and L.B. Polkowski, “Network models and the impact of modelling assumptions”, *J. of AWWA*, vol.68, no 4, April 1976.
- [13] Epp, R. and A.G. Fowler, “Efficient code for steady flows in networks.”, *J. Hydraulics Div.*, 96, pp. 43-56, 1970.
- [14] Gabrys, B., *Neural network based decision support: Modeling and simulation of water distribution networks*, Ph.D. Thesis, Nottingham Trent University, 1997.
- [15] Gabrys, B. and A. Bargiela, “Integrated neural based system for state estimation and confidence limit analysis in water networks.”, *Proc., Eur. Simulation Symp.*, SCS Publication, Genoa, vol. 2, pp.398-402, 1996.
- [16] Gofman E., and M. Rodeh, “Loop equations with unknown pipe characteristics”, *J. Hydraulics Div.*, 107(9), 1047-1060, 1982.
- [17] Hartley, J.K. and A. Bargiela, “Utilization of Smoothing Formula for Describing Hydraulic Relationships in Water Networks”, *Integrated Computer Applications in Water Supply*, In B. Coulbeck and C.H.Orr (Series Ed.), vol. 1, Research Studies Press, 1993.
- [18] Jeppson, R.W., *Analysis of flow in pipe networks*, Ann Arbor Science, Ann Arbor, Michigan, 1975.
- [19] Martin, D.W., and G. Peters, “The application of Newton’s method to network analysis by digital computer”, *Journal of Inst. Water Engineers*, vol. 17, 1963.
- [20] Nielsen, H.B., “Methods for analysing pipe networks.”, *J. Hydr. Engrg.*, 115(2), 139-157, 1989.
- [21] Powell, R.S., M.R. Irving, M.J.H. Sterling and A. Usman, “A comparison of three real-time state estimation methods for on-line monitoring of water distribution systems”, in *Computer Applications in Water Supply. Volume 1: Systems Analysis and Simulation*, Ed. B.Coulbeck and C.H.Orr, pp.333-348, Research Studies Press Ltd., 1988.
- [22] Rahal, C.M., *Parameter estimation for water distribution network modelling and control*, Ph.D. Thesis, Department of Control Engineering, University of Sheffield, 1980.
- [23] Rahal, H., “A co-tree flows formulation for steady-state in water distribution networks”, *Advances in Engineering Software*, vol.22, pp.169-178, 1995.
- [24] Rao, H.S., L.C. Markel, and D.W. Bree, “Extended period simulation of water systems – part A”, *J. Hydraulics Div.*, vol.103, pp. 97-108, 1977a.
- [25] Rao, H.S. and D.W. Bree, “Extended period simulation of water systems –part B”, *J. Hydraulics Div.*, vol.103, pp. 281-294, 1977b.
- [26] Sterling M.J.H. and A. Bargiela, “Minimum Norm State Estimation for Computer Control of Water Distribution Systems”, *IEE Proceedings*, vol.131, no.2, 1984.
- [27] Usman A., R.S. Powell, M.R. Irving, and M.J.H. Sterling, “Comparison of Colebrook-White and Hazen-Williams Flow Models in Real-Time Water Network Simulation”, in *Computer Applications in Water Supply. Volume 1: Systems Analysis and Simulation*, Ed. B.Coulbeck and C.H.Orr, pp.21-37, Research Studies Press Ltd., 1987.
- [28] Sterling M.J.H. and A. Bargiela, “Minimum Norm State Estimation for Computer Control of Water Distribution Systems”, *IEE Proceedings*, vol.131, no.2, 1984.
- [29] Wood, D.J., and C.O. Charles, “Hydraulic network analysis using linear theory.”, *J. Hydraulic Div.*, vol. 98, pp. 1157-1170, 1982.